



QUOTE FORM FOR FLANGED AND SCREW-IN IMMERSION HEATER


INQUIRY DATE: _____
 COMPANY: _____ CONTACT NAME: _____
 ADDRESS: _____ CITY: _____ STATE: _____ ZIP: _____
 PHONE: _____ FAX: _____ E-MAIL: _____

SPECIFICATIONS:

VOLTS: _____ WATTS: _____ PHASE: _____ WATT DENSITY: _____ BUSSING TYPE: _____
 HEATER ELEMENT: _____ (SERIES OR PARALLEL)
 QTY: _____ DIAMETER: _____ MATERIAL: _____ MINIMUM BUNDLE DIAMETER: _____
 MAXIMUM 'B' LENGTH: _____ SUPPORT RING: YES ___ NO ___ MAXIMUM COLD: _____ (MIN 2" COLD REQUIRED)
 (A SUPPORT RING IS AUTOMATICALLY ADDED TO EVERY 36" OF LENGTH)


FLANGED IMMERSION:

FLANGE SIZE: _____ PRESSURE CLASS: 150 LB ___ 300 LB ___ FLANGE MATERIAL: _____
 HOUSING ENCLOSURE: DUST RESISTANT ___ WATER RESISTANT ___ EXPLOSION RESISTANT ___

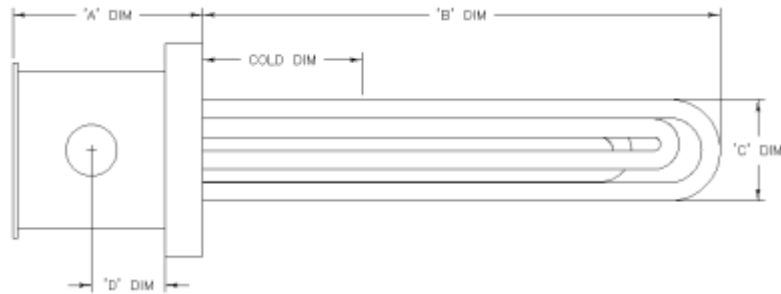

SCREW-IN IMMERSION:

NPT PIPE SIZE: _____ PIPE MATERIAL: _____ OPERATING PRESSURE: _____
 ENCLOSURE TYPE: GUA ___ GUAC ___ DUST RESISTANT ___ WATER RESISTANT ___ EXPLOSION RESISTANT ___

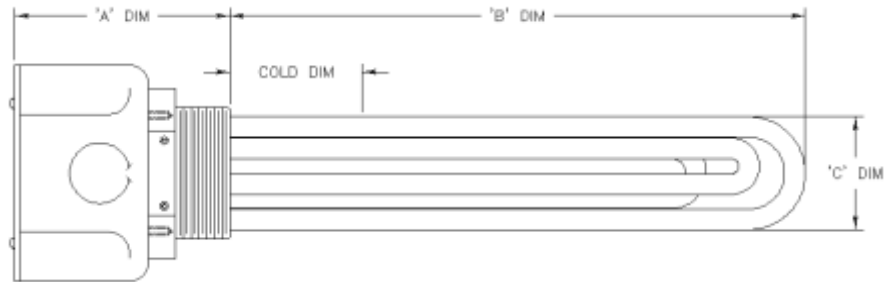

OPTIONS:

THERMOWELL: YES ___ NO ___ IF YES, DIAMETER _____ LENGTH _____
 INTEGRAL THERMOSTAT: YES ___ NO ___ IF YES, NOTE RANGE _____
 NOTE ANY SPECIAL REQUIREMENTS BELOW:

